


Diagram of Connections Marconi Models 22 & 23 (A.C.) Power Unit

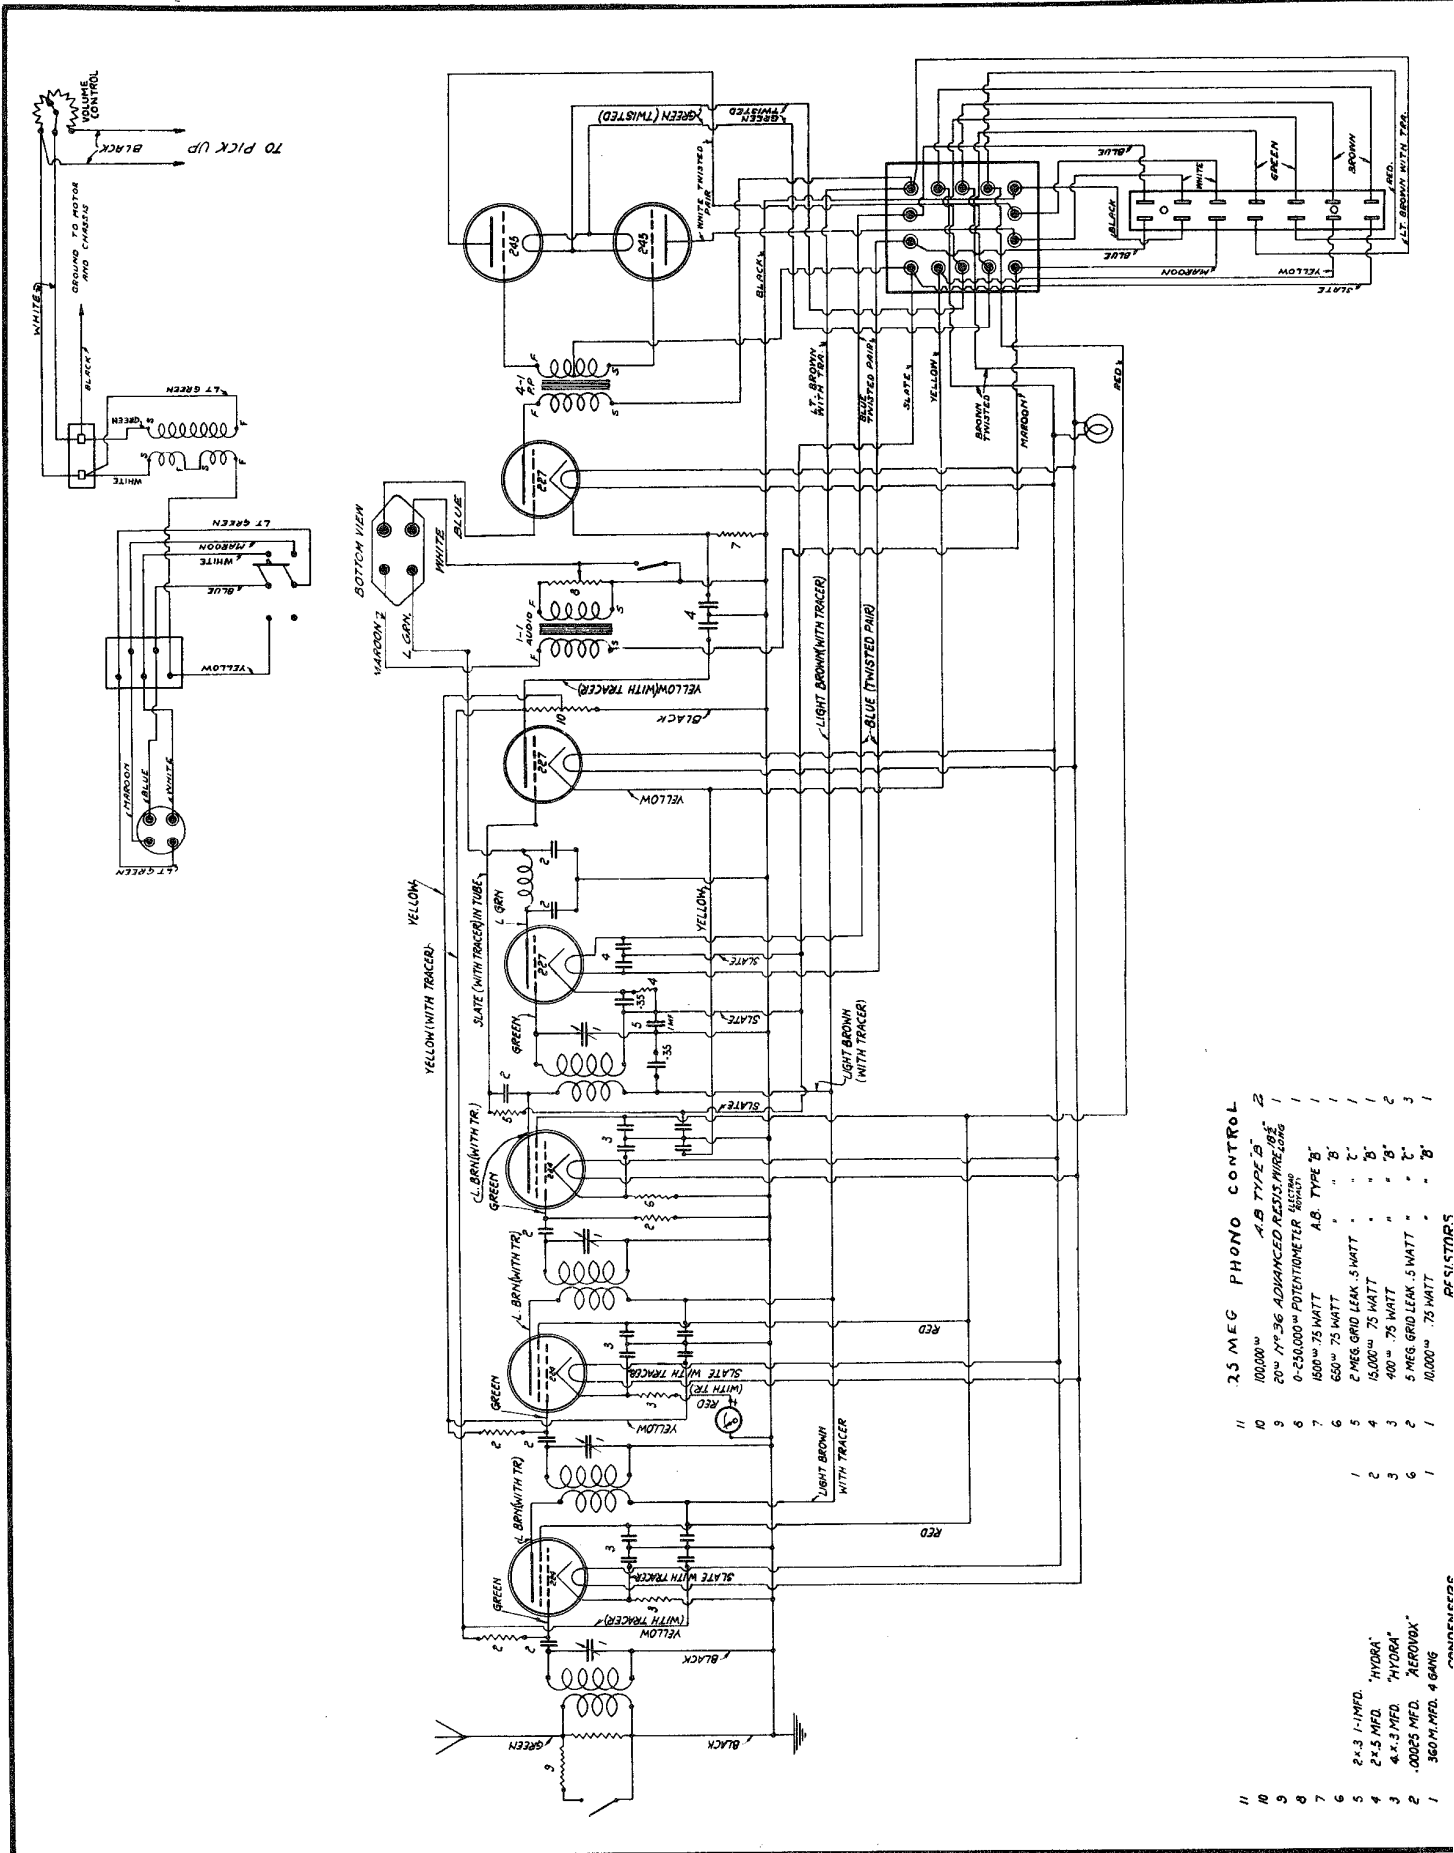

3.5 MEG PHONO CONTROL

| QTY | RESISTOR | PHONO CONTROL | A.B. TYPE | 2 |
|-----|----------------------------------|--|---------------|---|
| 11 | 100,000 Ω | | A.B. TYPE 'A' | 2 |
| 10 | 20 Ω | 20 Ω A.T. 36 ADVANCED RESIS. WIRE LOG | | 1 |
| 9 | 0-250,000 Ω POTENTIOMETER | | | 1 |
| 8 | 1500 Ω 75 WATT | | A.B. TYPE 'B' | 1 |
| 7 | 650 Ω 75 WATT | | " " 'B' | 1 |
| 6 | 2 MEG GRID LEAK .5 WATT | | " " 'B' | 1 |
| 5 | 15,000 Ω 75 WATT | | " " 'B' | 1 |
| 4 | 400 Ω .75 WATT | | " " 'B' | 2 |
| 3 | 5 MEG GRID LEAK .5 WATT | | " " 'B' | 3 |
| 2 | 10,000 Ω 75 WATT | | " " 'B' | 1 |
| 1 | | | | |

RESISTORS

Diagram of Connections Marconi Models 22 & 23 (A.C.) Chassis

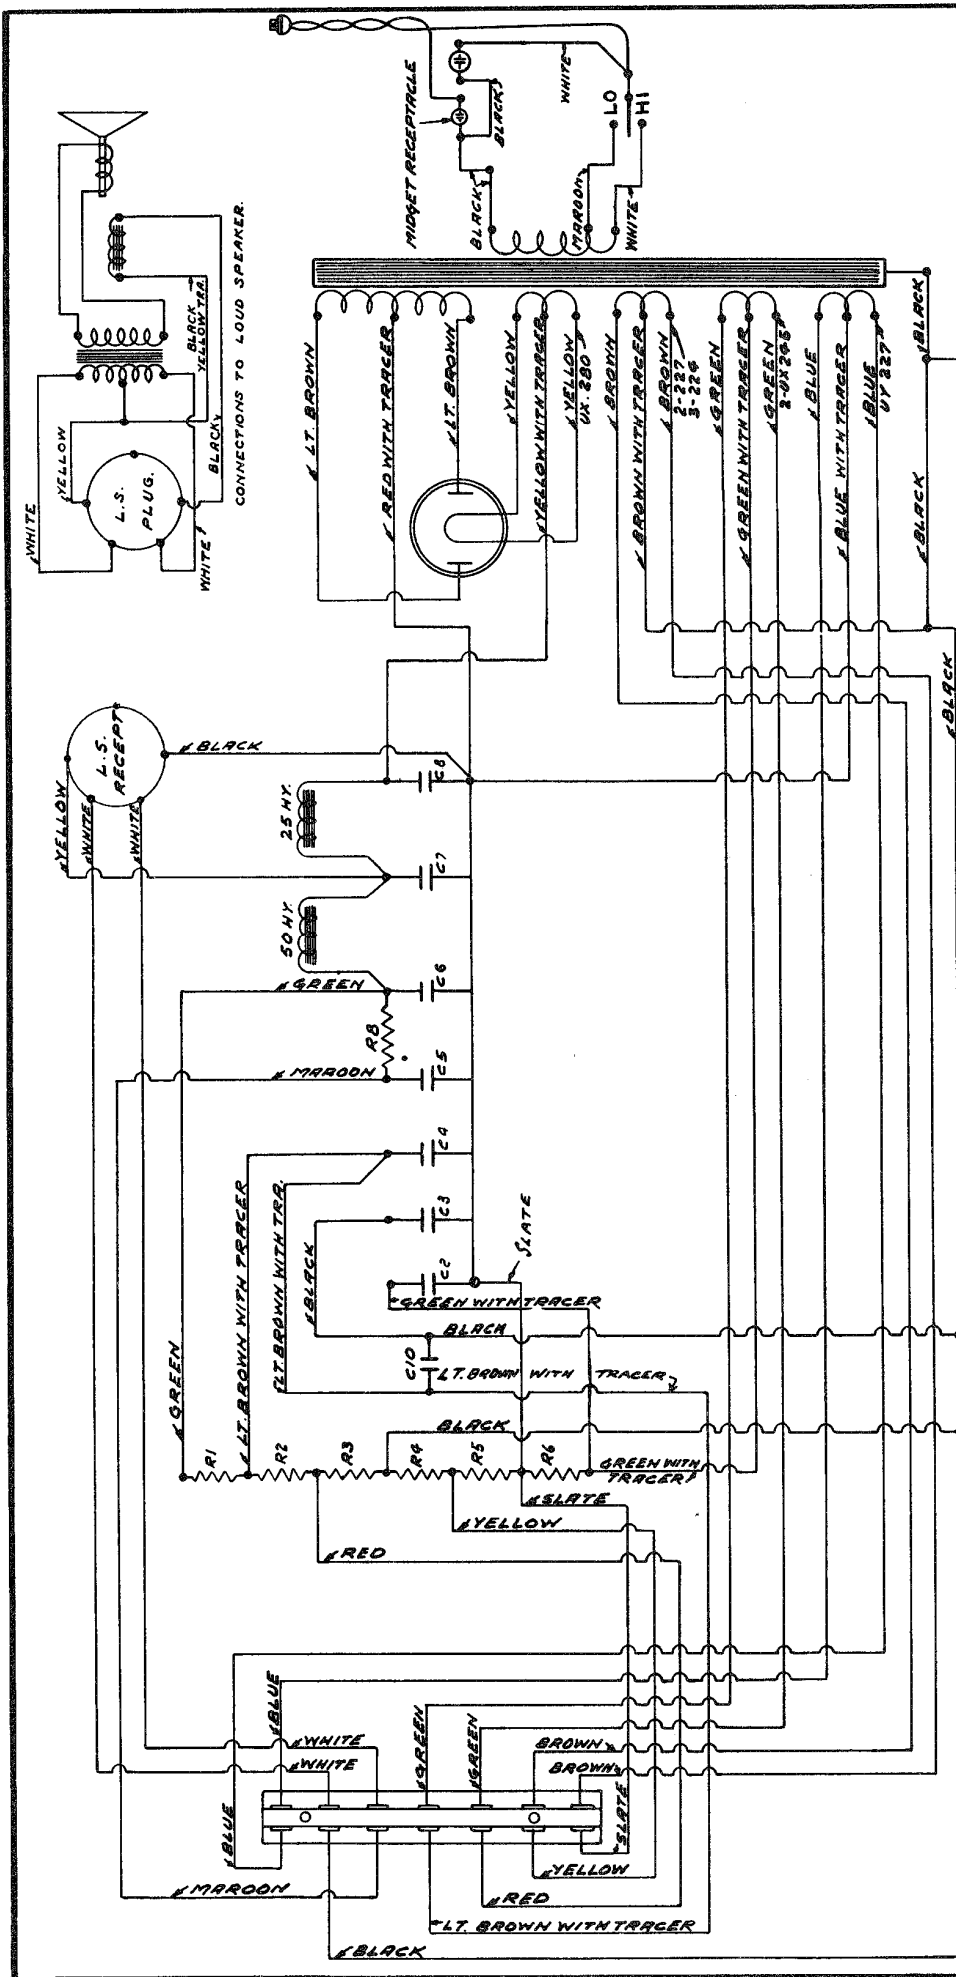


DIAGRAM SHOWS 1/4 POINT RECEPTACLE & L.S. RECEPTACLE AS SEEN WHEN LOOKING UNDER POWER UNIT.

| | | |
|----|------------------------|--------------------------------------|
| 11 | | 11 |
| 10 | 1 MFD. "HYDRA" | 10 |
| 9 | | 9 |
| 8 | 6 MFD. | 8 |
| 7 | 3 MFD. | 7 |
| 6 | 2 MFD. | 6 |
| 5 | 2 MFD. "16 MFD. HYDRA" | 5 |
| 4 | 1 MFD. | 4 |
| 3 | 1 MFD. | 3 |
| 2 | 1 MFD. | 2 |
| 1 | | 1 |
| | CONDENSERS | |
| | | RESISTANCES |
| | | 1000 OHMS RESISTOR 75 WATT R.B. TYPE |
| | | 760 OHMS |
| | | 285 OHMS |
| | | 1925 OHMS |
| | | 3500 OHMS |
| | | 4550 OHMS |
| | | 1150 OHMS |